

USER'S OPERATING MANUAL FOR DIGITAL PROCESS INDICATOR WITH ALARM

(Models:- PI - 44X / 77X / 88X / 99X)



PI - 44X
(48 X 48)



PI - 77X
(72 X 72)



PI - 88X
(48 X 96)



PI - 99X
(96 X 96)

SPECIFICATIONS: -

- 1. DISPLAY TYPE** : 4-Digit 7 segment LED (RED)

Model no.	PI-44X	PI-88X	PI-77X	PI-99X
Display height	0.36"	0.56"	0.56"	0.56"
- 2. INPUT**
 - Sensor Input : TC-J,K,R,S,N,T,B & RTD (PT-100)
 - Analog Input : 0 - 20mA, 4 - 20mA, 0 - 1VDC, 0 - 5VDC, 0 - 3.3VDC, 0 - 10VDC (Selectable)
 - Range : -1999 to 9999
 - Resolution : 0.001, 0.01, 0.1 & 1°C (Selectable)
 - Digital Filter : 1 to 10 (Selectable)
- 3. OUTPUT** : 2 Nos. Relay / SSR (Need to specify)
 - a) Relay Output**
 - Contact type : N/O, CM, N/C
 - Contact Rating : 5A @ 250VAC or 30 VDC
 - Life expectancy : > 5,00,000 operations
 - Isolation : Inherent
 - b) SSR Drive Output**
 - Drive Capacity: 12V @ 30mA.
 - Isolation : Non-Isolated.
- 4. FUNCTION** : Both output work as Alarm
- 5. ENVIRONMENTAL**
 - Operating Range : 0 ~50°C, 5~90% Rh
 - Storage Humidity : 95% Rh (Non-condensing)
- 6. POWER SUPPLY**
 - Supply Voltage : 90~270VAC, 50/60Hz.
 - Consumption : 4W Maximum.
- 7. PHYSICAL**
 - Housing : ABS Plastic.

SAFETY INSTRUCTION :-

GENERAL

- ❖ The controller must be configured correctly for intended operation. Incorrect configuration could result in damage to the equipment or the process under control.
- ❖ The controller is generally part of control panel and in such a case the terminals should not remain accessible to the user after installation.

MECHANICAL


- ❖ The Controller in its installed state must not come in close proximity to any corrosive/combustible gases, caustic vapors, oils, steam or any other process by-products.
- ❖ The Controller in its installed state should not be exposed to carbon dust, salt air, direct sunlight or radiant heat
- ❖ Ambient temperature and relative humidity surrounding the controller must not exceed the maximum specified limit for proper operation of the controller.

ELECTRICAL


- ❖ The controller must be wired as per wiring diagram & it must comply with local electrical regulation.
- ❖ Circuit breaker or mains s/w with fuse (275V/1A) must be installed between power supply and supply terminals to protect the controller from any possible damage due to high voltage surges of extended duration.
- ❖ Circuit breaker and appropriate fuses must be used for driving high voltage loads to protect the controller from any possible damage due to short circuit on loads.
- ❖ To minimize pickup of electrical noise, the wiring for low voltage DC and sensor input must be routed away from high current power cables. Where it is impractical to do so, use shielded ground at both ends.

OVER ALL DIMENSIONS & PANEL CUT OUT (IN MM)

MODEL:-PI-44X / PI-77X / PI-99X

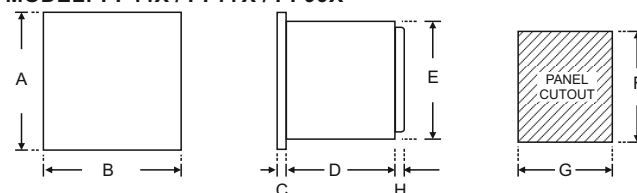


MODEL : PI-88X

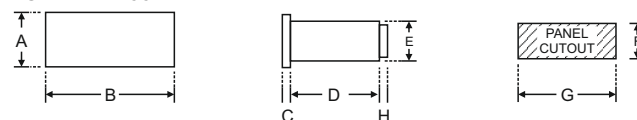

Over all Dimensions:-

Dim Model	A	B	C	D	E	F	G	H
PI-44X	48	48	8	85	43	44	44	9
PI-77X	72	72	10	65	66	68	68	9
PI-99X	96	96	10	53	89	92	92	9
PI-88X	48	96	10	53	43	44	92	9

TERMINAL DIAGRAM :-

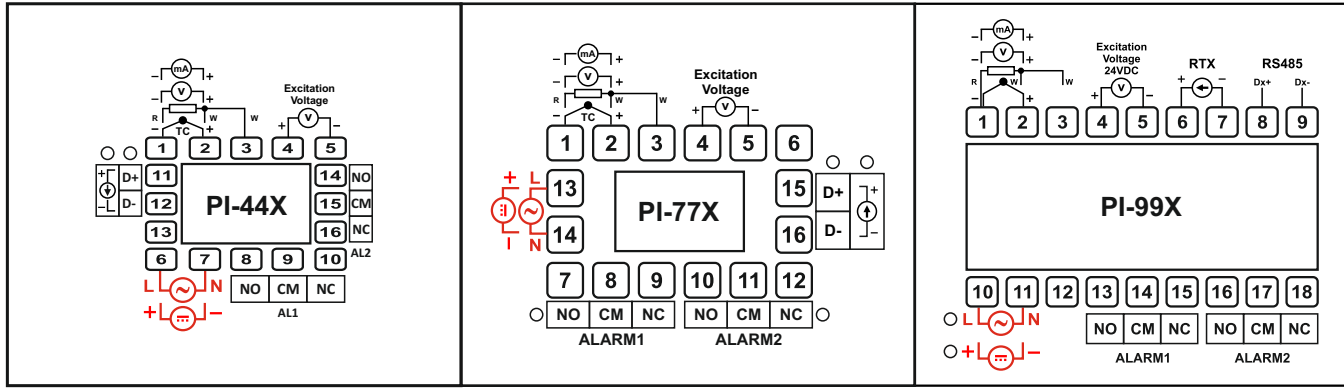

PROGRAMMING:-

USER LIST:-

- (1) To enter in this mode, Press and hold SET Once.
 - (2) Press UP or DOWN key to scroll between parameter options.
 - (3) Press SET key to store the current parameter & move on to the next parameter.
- (All following selected parameter's code shown in shaded will be displayed for 1 sec. followed by their values / options)

PARAMETER	DISPLAY	RANGE	DESCRIPTION	DEFAULT
Alarm 1 Set Point	A1SP > <input type="text" value="0"/>	Ai.Lo ~ Ai.Hi	User can change the 'Alarm 1 Set point' value using UP/ DOWN keys. Holding the key will change the value at a faster rate. Press SET key to store the desired value and move on to the next parameter.	0
Alarm 1 Band	A1bd > <input type="text" value="0"/>	-50 ~ 50	This parameter will appear only if, In Control list Alarm 1 type(A1.Ty) as Band Selected. User can change the 'Alarm 1 Band' value using UP/ DOWN keys. Press SET key to store the desired value and move on to the next parameter. For range limit as per resolution selected Ref. Table No.2 (Page No. 8).	0
Alarm 2 Set Point	A2SP > <input type="text" value="0"/>	Ai.Lo ~ Ai.Hi	User can change the 'Alarm 2 Set point' value using UP/ DOWN keys. Holding the key will change the value at a faster rate. Press SET key to store the desired value and move on to the next parameter.	0
Alarm 2 Band	A2bd > <input type="text" value="0"/>	-50 ~ 50	This parameter will appear only if, In Control list Alarm 2 type(A2.Ty) as Band Selected. User can change the 'Alarm 2 Band' value using UP/ DOWN keys. Press SET key to store the desired value and move on to the next parameter. For range limit as per resolution selected Ref. Table No.2 (Page No. 8).	0

CONTROL LIST:-

- (1) To enter in this mode, Press and hold SET & DOWN key simultaneously for 3 sec.
 - (2) Press UP or DOWN key to scroll between parameter options.
 - (3) Press SET key to store the current parameter & move on to the next parameter.
- (All following selected parameter's code shown in shaded will be displayed for 1 sec. followed by their values / options)

PARAMETER	DISPLAY	DESCRIPTION	DEFAULT
ALARM LOCK CODE	ALLP > <input type="text" value="0"/>	Set this parameter to 15 (Default LOCK CODE) to access Control List. User has a choice to set different Lock Code via USER LOCK CODE(U.LCK) in Configuration List.	0
ALARM 1 TYPE	A1Ty > <input type="text" value="LOy"/> ↓ ↑ HiCh ↓ ↑ Band	Direct acting	Reverse acting
		Low Alarm:- Op1 activates when PV < A1.SP. 	Op1 activates when PV > A1.SP.
		High Alarm:- Op1 activates when PV > A1.SP. 	Op1 activates when PV < A1.SP.
		Band Alarm:- Op1 activates when PV falls outside the Alarm 1 Band w.r.t. Alarm 1 Set point in either direction. 	Op1 activates when PV falls Inside the Alarm 1 Band w.r.t. Alarm 1 Set point in either direction.
		Low	

PARAMETER	DISPLAY	DESCRIPTION	DEFAULT
ALARM 1 LOGIC		If this parameter is set as 'Direct', Relay/SSR energizes under Alarm condition & remains De-energized otherwise. 'Direct' setting is generally used for Audio/Visual Alarm Output.	Direct
		If this parameter is set as 'Reverse', Relay/SSR De-energizes under Alarm condition & remains energized otherwise. 'Reverse' setting is generally used for tripping the process under Alarm condition.	
ALARM 1 INHIBIT		This parameter can be used to inhibit (suppress) the Alarm 1 activation upon power-up conditions by setting the parameter value to 'YES'. From Power-up, the Alarm system remains disabled until PV is found within the limits.	No
		If Alarm 1 activation is desired even under Power-up condition, Set this parameter value to 'NO'.	
ALARM 1 ACK.		Once Alarm 1 is activated, user has following three options to de-activate it. <u>Auto</u> :- When PV falls within the programmed limits, Alarm 1 will be de-activated automatically.	Auto
		<u>Manual</u> :- Once Alarm 1 is activated, it remains activated until manually acknowledged by UP key.	
		<u>Both</u> :- Once Alarm 1 is activated, it can be de-activated either by pressing UP key or when PV falls within the alarm limits.	
ALARM 1 Hysteresis		It sets the dead band between ON & OFF switching of the Output. Larger value of hysteresis minimize the number of ON-OFF operation of load. This increases life of actuators like contactors. For range limit as per resolution selected Ref. Table No.2 (Page No. 8).	2°C
ALARM 1 SET POINT		If Enabled, User can View & edit the Alarm 1 Set point (A1.SP) & Alarm 1 Band(A1.bd) in USER list.	Enable
		If disabled, User can only View but can not edit Alarm 1 Set Point (A1.SP) & Alarm 1 Band(A1.bd) in USER list.	
ALARM 2 TYPE		Direct acting	Reverse acting
		<u>Low Alarm:-</u> Op1 activates when PV<A2.SP. 	<u>High Alarm:-</u> Op1 activates when PV>A2.SP.
		<u>High Alarm:-</u> Op1 activates when PV>A2.SP. 	<u>Low Alarm:-</u> Op1 activates when PV<A2.SP.
		<u>Band Alarm:-</u> Op1 activates when PV falls outside the Alarm 1 Band w.r.t. Alarm 1 Set point in either direction. 	<u>Band Alarm:-</u> Op1 activates when PV falls Inside the Alarm 1 Band w.r.t. Alarm 1 Set point in either direction.
ALARM 2 LOGIC		If this parameter is set as 'Direct', Relay/SSR energizes under Alarm condition & remains De-energized otherwise. 'Direct' setting is generally used for Audio/Visual Alarm Output.	Direct
		If this parameter is set as 'Reverse', Relay/SSR De-energizes under Alarm condition & remains energized otherwise. 'Reverse' setting is generally used for tripping the process under Alarm condition.	
ALARM 2 INHIBIT		This parameter can be used to inhibit (suppress) the Alarm 1 activation upon power-up conditions by setting the parameter value to 'YES'. From Power-up, the Alarm system remains disabled until PV is found within the limits.	No
		If Alarm 1 activation is desired even under Power-up condition, Set this parameter value to 'NO'.	

PARA METER	DISPLAY	DESCRIPTION	DEFAULT
ALARM 2 ACK.	A2.AP > AUTO	Once Alarm 2 is activated, user has following three options to de-activate it. <u>Auto</u> :- When PV falls within the programmed limits, Alarm 2 will be de-activated automatically.	Auto
	ARUL	<u>Manual</u> :- Once Alarm 2 is activated, it remains activated until manually acknowledged by DN key.	
	BOtH	<u>Both</u> :- Once Alarm 2 is activated, it can be de-activated either by pressing DN key or when PV falls within the alarm limits.	
ALARM 2 Hysterisis	A2.HY > 0.2	It sets the dead band between ON & OFF switching of the Output. Larger value of hysteresis minimize the number of ON-OFF operation of load. This increases life of actuators like contactors. For range limit as per resolution selected Ref. Table No.2 (Page No. 8).	2°C
ALARM 2 SET POINT	A2.SP > Enbl	If Enabled, User can View & edit the Alarm 2 Set point (A2.SP) & Alarm 2 Band(A2.bd) in USER list.	Enable
	d5bL	If disabled, User can only View but can not edit Alarm 2 Set Point (A2.SP) & Alarm 2 Band(A2.bd) in USER list.	

CONFIGURATION LIST:-

- (1) To enter in this mode, Press and hold SET & UP key simultaneously for 3 sec.
- (2) Press UP or DOWN key to scroll between parameter options.
- (3) Press SET key to store the current parameter & move on to the next parameter.

(All following selected parameter's code shown in shaded will be displayed for 1 sec. followed by their values / options)

PARA METER	DISPLAY	DESCRIPTION	DEFAULT
CONFIG LOCK CODE	cnLP > 0	Set this parameter to 15 (Default LOCK CODE) to access Configuration List. User has a choice to set different Lock Code in the range 1 ~ 9999 via USER LOCK CODE in Configuration List.	0
Input Types	InPt	'TC-J' :- If selected, instrument will accept temperature input from thermocouple J type sensor at rear terminal. Below range it will display 'LLLL' message & above range it will display 'HHHH'.	TC-J
	TC-J	'TC-K' :- If selected, instrument will accept temperature input from thermocouple K type sensor at rear terminal. Below range it will display 'LLLL' message & above range it will display 'HHHH'.	
	TC-K	'TC-R' :- If selected, instrument will accept temperature input from thermocouple R type sensor at rear terminal. Below range it will display 'LLLL' message & above range it will display 'HHHH'.	
	TC-R	'TC-S' :- If selected, instrument will accept temperature input from thermocouple S type sensor at rear terminal. Below range it will display 'LLLL' message & above range it will display 'HHHH'.	
	TC-S	'TC-N' :- If selected, instrument will accept temperature input from thermocouple N type sensor at rear terminal. Below range it will display 'LLLL' message & above range it will display 'HHHH'.	
	TC-N	'TC-T' :- If selected, instrument will accept temperature input from thermocouple N type sensor at rear terminal. Below range it will display 'LLLL' message & above range it will display 'HHHH'.	
	TC-T	'TC-B' :- If selected, instrument will accept temperature input from thermocouple B type sensor at rear terminal. Below range it will display 'LLLL' message & above range it will display 'HHHH'.	
	TC-B	'RTD' :- If selected, instrument will accept temperature input from PT-100 sensor at rear terminal. Below range it will display 'LLLL' message & above range it will display 'HHHH'.	
	RTD	'RTD.1' :- If selected, instrument will accept temperature input from PT-100 sensor at rear terminal. Below range it will display 'LLLL' message & above range it will display 'HHHH'.	
	RTD.1	'0 - 1' :- If selected, instrument will accept 0 - 1VDC input at rear terminal. Below 0V it will display 'LLLL' message & above 1V it will display 'HHHH'.	
	0-1	'0 - 3.3' :- If selected, instrument will accept 0 - 3.3VDC input at rear terminal. Below 0V it will display 'LLLL' message & above 3.3V it will display 'HHHH'.	
	0-3.3	'0 - 5' :- If selected, instrument will accept 0 - 5 VDC input at rear terminal. Below 0V it will display 'LLLL' message & above 5V it will display 'HHHH'.	
	0-5	'0 - 10' :- If selected, instrument will accept 0 - 10VDC input at rear terminal. Below 0V it will display 'LLLL' message & Above 10V it will display 'HHHH'.	
	0-10	'0 - 20' :- If selected, instrument will accept 0 - 20 mA input at rear terminal. Below 0 mA it will display 'LLLL' message & Above 20 mA it will display 'HHHH'.	
0-20	'4 - 20' :- If selected, instrument will accept 4 - 20mA input at rear terminal. Below 3.8mA it will display 'LLLL' message & Above 20mA it will display 'HHHH'. If input is less than 3.2mA it will display 'L.BRK'(Loop Break) message.		
4-20			

PARAMETER	DISPLAY	DESCRIPTION	DEFAULT
RESOLUTION	 	<p>This parameter will NOT be prompted when input type is selected as Thermocouple (TC-J,K,R,S,N & B) & RTD.</p> <p>By this parameter user can select four format of resolution only for analog input, i.e. "0.000, 0.00, 0.0, 0". For range limit as per resolution selected Ref. Table No.2 (Page No. 8).</p>	0
ANALOG INPUT LOW VALUE		<p>By this parameter user can define Low scale for input signal. Which can be in between '-1999 to Ai.Hi'. For range limit as per resolution selected Ref. Table No.2 (Page No. 8).</p>	0
ANALOG INPUT HIGH VALUE		<p>By this parameter user can define HIGH scale for input signal. Which can be in between 'Ai.Lo to 9999'. For range limit as per resolution selected Ref. Table No.2 (Page No. 8).</p>	1200
LOWER SP LIMIT		<p>This parameter will only be prompted if Input type is thermocouple or RTD. Sets the minimum limit for set point adjustment. It can be set from minimum specified range of selected sensor to HSPL value. For range limit as per sensor selected Ref. Table No.1 (Page No. 8).</p>	0 °C
HIGHER SP LIMIT		<p>This parameter will only be prompted if Input type is thermocouple or RTD. Sets the maximum limit for set point adjustment. It can be set from LSPL value to maximum specified range of selected sensor. For range limit as per sensor selected Ref. Table No.1 (Page No. 8).</p>	400 °C
Analogue Input Logic	 	<p>By this parameter user can select the logic of the Analog Input. 'DIR' :- If selected then the value will vary from Ai.Lo to Ai.Hi. 'REV' :- If selected then the value will vary from Ai.Hi to Ai.Lo.</p>	Dir
PROCESS VALUE OFFSET		<p>Function of this parameter is to add/subtract a constant value to the measured PV to obtain Final PV. For range limit as per resolution selected Ref. Table No.2 (Page No. 8).</p>	0
INPUT FILTER		<p>Controller is equipped with an adaptive digital filter which is used to filter out any extraneous pulses on the PV. Filtered PV Value is used for all PV dependent functions. If PV signal is fluctuating due to noise, increase the filter time constant value.</p>	04
mA Output Type	 	<p>This parameter will be prompted only if factory set control output is "mA". If "0~20" Selected, Control Output will be 0~20 mA. If "4~20" Selected, Control Output will be 4~20 mA.</p>	4~20 mA
RE-Tx Direction	 	<p>If this parameter is set as 'Direct', the retransmission output is 4 mA at Ai.Lo value and 20 mA at Ai.Hi value If this parameter is set as 'Reverse', the retransmission output is 20 mA at Ai.Lo value and 4 mA at Ai.Hi value</p>	Direct
RE-Tx Low Value		<p>By this parameter user can define Low scale for Retransmission. Which can be in between '-1999 to rt.Hi'.</p>	0
RE-Tx High Value		<p>By this parameter user can define High scale for Retransmission. Which can be in between 'rt.Lo to 9999'.</p>	1200
RE-Tx Error	 	<p>In case of error condition, the retransmission output will be 4 mA. In case of error condition, the retransmission output will be 20 mA. In case of error condition, the retransmission output will be 0 mA. In case of error condition, the retransmission output will be 22 mA.</p>	US.Lo

PARAMETER	DISPLAY	DESCRIPTION	DEFAULT
Device ID Number 1	Id-1 <input type="text" value="1"/>	Set device id for communication. Range:- 1 to 9999.	1
Baud Rate	baud <input type="text" value="9600"/> ↓ ↑ <input type="text" value="1920"/> ↓ ↑ <input type="text" value="3125"/> ↓ ↑ <input type="text" value="3840"/> ↓ ↑ <input type="text" value="7680"/>	By this parameter user can select baud rate for communication purpose.	9600
Parity	PAR <input type="text" value="n_81"/> ↓ ↑ <input type="text" value="n_82"/> ↓ ↑ <input type="text" value="o_81"/> ↓ ↑ <input type="text" value="o_82"/> ↓ ↑ <input type="text" value="E_81"/> ↓ ↑ <input type="text" value="E_82"/>	By this parameter user can select parity for communication purpose.	0_81
RS-485 response interval	[ntu] <input type="text" value="1"/>	Widen the time interval of receiving response (Set value x 20 ms)	1(20ms)
USER LOCK CODE	ULOC > <input type="text" value="15"/>	Default USER LOCK CODE is 15 to access Control & Configuration List. User has a choice to set its own USER LOCK CODE between 1 to 9999, this is to prevent unauthorized access of Control & Configuration List.	15

User Calibration List:-

- (1) To enter in this mode, Press and hold SHIFT key simultaneously for 3 sec.
 - (2) Press UP or DOWN key to scroll between parameter options.
 - (3) Press SET key to store the current parameter & move on to the next parameter.
- (All following selected parameter's code shown in shaded will be displayed for 1 sec. followed by their values / options)

PARAMETER	DISPLAY	DESCRIPTION	DEFAULT
User Calib. Lock	UCLP > <input type="text" value="0"/>	Set this parameter to "7" (Default LOCK CODE) to access User Calibration List.	7
Calibration Type	10ty > <input type="text" value="IP"/> ↓ ↑ <input type="text" value="OP"/>	This parameter allows the user to select and calibrate either input or output other than the factory programmed values.	Input Type

A) When calibration type INPUT is selected :-

(Calibration can **ONLY** be done of the Analog Input Type selected in Configuration List.)

PARAMETER	DISPLAY	DESCRIPTION	DEFAULT
Low Calibration		This parameter allows the user to program "Lower Calibration" values other than factory programmed values. With the help of Up / Down Key "Low Calibration" can be adjusted (As per selected input apply Low mA/Volt at input terminal).	0
High Calibration		This parameter allows the user to program "Higher calibration" values other than factory programmed values. With the help of Up / Down Key "High Calibration" can be adjusted (As per selected input apply High mA/Volt at input terminal)	9999
Factory Default		<p>Yes:- If selected, User calibration will be canceled and instrument will run on factory set calibration values.</p> <p>No:- If selected, there is no effect on User Calibration and instrument will run as per User defined Calibration values.</p>	No

B) When calibration type OUTPUT is selected :-

PARAMETER	DISPLAY	DESCRIPTION	DEFAULT
Output Type		This parameter allows the user to calibrate either 0 - 20 or 4 - 20 mA in output.	0 - 20
mA Low Calibration		This parameter will be prompted only if factory set control output is "mA". By this parameter user can adjust Lower calibration for Selected mA type. (Adjust 0mA on meter if 0~20 selected or 4mA on meter if 4~20 selected).	16.70
mA High Calibration		This parameter will be prompted only if factory set control output is "mA". By this parameter user can adjust Higher calibration for Selected mA type. (Adjust 20mA on Meter with this parameter).	85.50
mA Default		<p>This parameter will be prompted only if factory set control output is "mA".</p> <p>If "Yes" Selected, User Calibration will be replaced with Factory Calibration.</p> <p>If "No" Selected, No change in User Calibration.</p>	No

Table 1 :- Range of Different Sensor Types.

Sensor Type	Range	Resolution	Accuracy
Fe-k(J) T/C	0 ~ 760°C	1 °C	± 1 °C
Cr-AL(K) T/C	-99 ~ 1300°C	1 °C	
(R) T/C	0 ~ 1700°C	1 °C	
(S) T/C	0 ~ 1700°C	1 °C	
TC - N	-99 ~ 1300°C	1 °C	
TC - T	-99 ~ 400°C	1 °C	
TC - B	0 ~ 1800°C	1 °C	
Pt-100(RTD)	-100 ~ 450°C	1 °C	
Pt-100(RTD 0.1)	-100.0 ~ 450.0°C	0.1 °C	± 0.3 °C

Table 2 :- Range as per Resolution.

Resolution	Analog Input Low Value	Analog Input High Value	Process Value Offset	Alarm 1 Band	Alarm 2 Band	ALARM 1 Hysterisis	ALARM 2 Hysterisis
0000	-1999 to 9999	-1999 to 9999	-25 to 25	-50 to 50	-50 to 50	1 to 25	1 to 25
000.0	-199.9 to 999.9	-199.9 to 999.9	-25.0 to 25.0	-50.0 to 50.0	-50.0 to 50.0	0.1 to 25.0	0.1 to 25.0
00.00	-19.99 to 99.99	-19.99 to 99.99	-15.00 to 25.00	-19.00 to 50.00	-19.00 to 50.00	0.01 to 25.00	0.01 to 25.00
0.000	-1.999 to 9.999	-1.999 to 9.999	-1.500 to 2.500	-1.900 to 5.000	-1.900 to 5.000	0.001 to 2.500	0.001 to 2.500

Error Message:-

Display Message	Selected Input	Descriptions
"OPEN"	TC-J,K,R,S,N,B or RTD	Open Circuit of Control Sensor
"HHHH"	TC-J,K,R,S,N,B or RTD	If input is above HSPL it will display "HHHH" message.
"HHHH"	0 ~ 20 / 4 ~ 20 / 0 ~ 10	If input is above range it will display "HHHH" message.
"LLLL"	TC - J,K,R,S,N,B or RTD	If input is below LSPL it will display "LLLL" message.
"LLLL"	0 ~ 20 / 0 ~ 10	If input is below '0' it will display "LLLL" message.
"LLLL"	4 ~ 20	If input is below "3.8mA" and above "3.2mA" it will display "LLLL" message.
"L.BRK"	4 ~ 20	If input is less than "3.2mA" it will display "L.BRK" (Loop Break) message.
"C.E.R.R."	Any Input Selected	The device is out of calibration and need to be sent to factory for re-calibration.



Mfgd by: Innovative Instruments & Controls LLP

Unit no 101- 105, Patel Industrial Estate, Building No.5, Near Range office, Gauripada, Vasai East, Palghar, Maharashtra 401208.

Sales : +91-8591939916 / 17 / +91-8655832205

Support : +91-7208897610

E-mail : sales@itherm.co.in

Website : www.itherm.co.in

